

# GAS INSULATED SWITCHGEAR (GIS) MONITORING OF SF<sub>6</sub> USING PRECISE NDIR SENSOR TECHNOLOGY

The integrity and safety of electrical switchgear are paramount in any power distribution system. Sulphur Hexafluoride (SF<sub>6</sub>) is widely used as an insulating and quenching medium in switchgear because of its outstanding electrical properties and chemical stability. However, monitoring SF<sub>6</sub> gas is critical, as it is a potent greenhouse gas. Cambridge Sensotec stands at the forefront of SF<sub>6</sub> gas analysis, ensuring the safe and efficient operation of electrical switchgear across various industries. This was achieved by using the latest NDIR sensor technology developed and produced by Wi.Tec-Sensorik GmbH.

## Introduction

A gas-insulated switchgear (GIS) is a completely gas-tight encapsulated switchgear for high voltage and medium voltage, which surrounds the electrical conductor(s) with sulfur hexafluoride (SF<sub>6</sub>) as a protective gas for insulation. In contrast to air-insulated switchgear (AIS), this allows compact switchgear to be installed in confined spaces.


Gas-insulated switchgear is much more compact than air-insulated switchgear because SF<sub>6</sub> has four times the dielectric strength of air at normal pressure. In addition, SF<sub>6</sub> supports the extinguishing of spark gaps more effectively than air. Gas-insulated switchgear is generally designed for indoor use but can easily be converted for outdoor use.

The insulating gas is kept at a pressure of 5 bar to 10 bar to ensure insulation capability. The reason for the higher gas pressure compared to normal pressure is that the average path length of the free electrons in the gas is reduced. Due to the electric field strength, electrons cannot be accelerated as strongly on average at high gas pressure as at normal pressure and collide with the SF<sub>6</sub> molecules.

As SF<sub>6</sub> is a greenhouse gas with a GWP<sup>1</sup> of 23,500 (EPA), great efforts are being made to prevent leaks. However, there are now exemptions for gas-insulated switchgear, which are justified on the grounds of small quantities of escaping gas and proper disposal. Furthermore, various gas mixtures such as nitrogen (N<sub>2</sub>) and carbon dioxide (CO<sub>2</sub>) can be used to reduce the absolute proportion of SF<sub>6</sub> in the insulating gas. For gas-insulated pipelines (GIL) without switching operations in the pipe sections, the SF<sub>6</sub> content can be reduced to around 5%. However, these mixed gases are more sensitive to impurities. Impurities lead to a reduction in the insulation strength and require a higher gas pressure, which increases the mechanical effort and system costs.

## Sulfur Hexafluoride

SF<sub>6</sub> is an extremely stable, non-flammable and highly electronegative gas with excellent dielectric properties. It is commonly used in medium and high-voltage electrical equipment as an electrical insulator, arc-quenching and cooling medium. However, SF<sub>6</sub> is classified as a greenhouse gas and must be kept within a closed circuit to avoid any deliberate release into the atmosphere. The international Kyoto agreement protocol has mandated reductions to harmful emissions amongst its member states. For the power transmission and distribution network, SF<sub>6</sub> technology remains essential. To protect personnel, equipment and the environment regular SF<sub>6</sub> analysis should be adopted within the maintenance schedule. The early identification of any decomposition products and moisture within the SF<sub>6</sub> gas will help avoid unnecessary shutdowns, outages and failures, in addition to reducing maintenance expenditures.

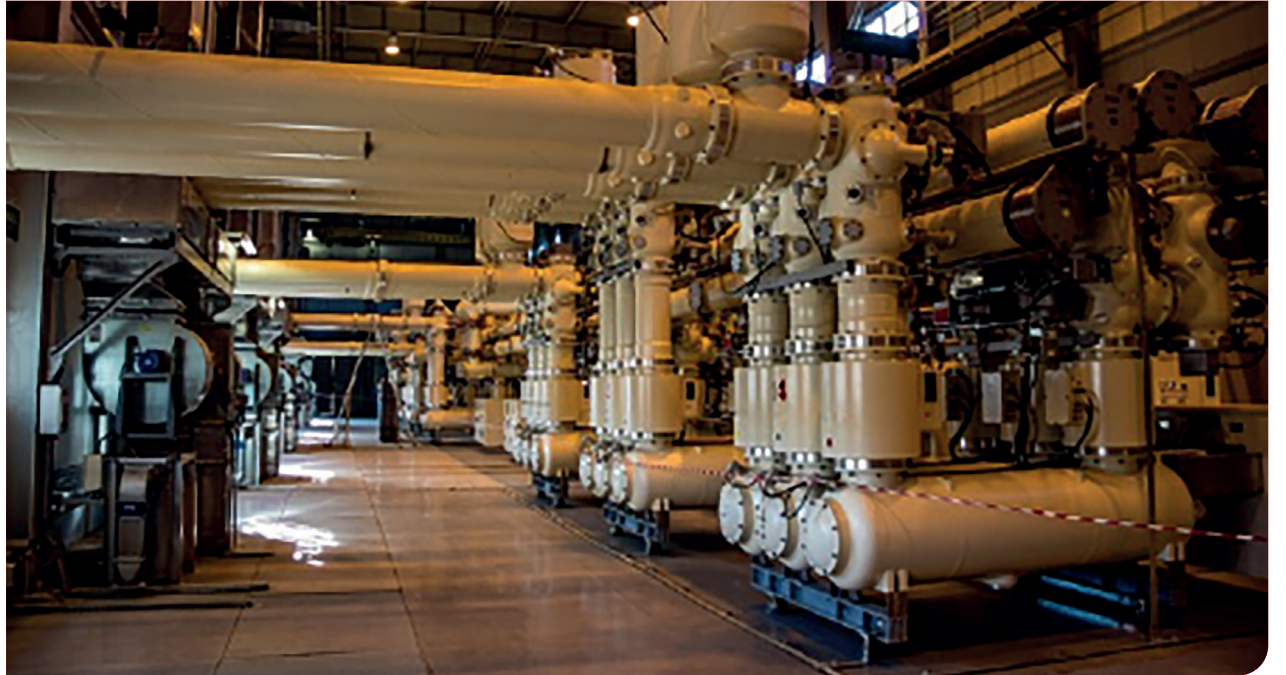

## GIS

Several applications for measuring SF<sub>6</sub> exist in a GIS. The first is the gas concentration in the close GIS chamber. Ideally, this concentration is always 100% by volume. Due to unavoidable leakages, this concentration can reduce over several years. To record this process reliably, the measuring range between 90-100 vol.% must be particularly accurate. This application is described in this report. This measurement situation is shown in Figure 1. This measurement is repeated at regular intervals to determine the course of the SF<sub>6</sub> concentration and to identify leaks. For an online monitoring a gas density meter is also integrated into the system.

It is also possible to detect leaks in the system and the supply lines with a leak detector. In this case, the typical measuring range is 0-1000ppm SF<sub>6</sub>.

In the room air control (accumulation of SF<sub>6</sub> in the room), gas concentrations around the zero point are required. The typical measuring range in this case is 0-50ppm SF<sub>6</sub>.

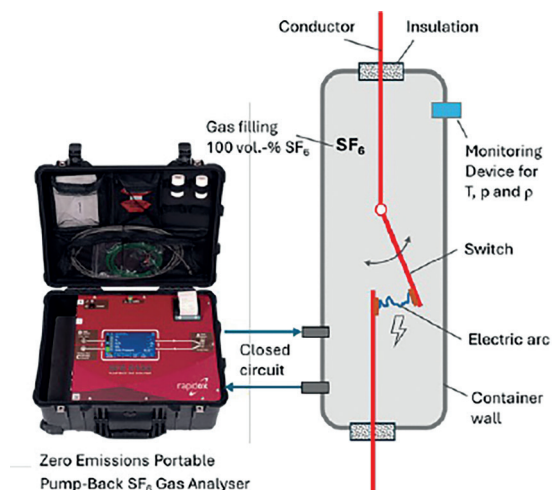


Figure 1: Checking a GIS with a zero emissions portable gas analyzer from the Rapidox series.

## Instruments

Cambridge Sensotec Ltd, has been manufacturing a range of SF<sub>6</sub> portable and bench testing equipment for more than fifteen years. Typically, three important gases are measured: SF<sub>6</sub> purity (typically 97-100%), H<sub>2</sub>O water content (target <-36°Cdp) and SO<sub>2</sub> arc indicator toxic gas (target < 1 ppm). Other gases such as HF, CF<sub>4</sub>, O<sub>2</sub>, CO and H<sub>2</sub>S are measured using electrochemical sensors where required.

In accordance with IEC and CIGRE requirements, the preferred measurement technology for SF<sub>6</sub> analysis is nondispersive infra-red (NDIR), which, unlike other methods such as speed-of-sound or thermal conductivity, is a direct measurement of

the SF<sub>6</sub> itself. Most of the modern-day test equipment is highly portable and battery powered so there are huge challenges in obtaining accurate SF<sub>6</sub> readings in differing environmental conditions of temperature and altitude around the World, as well as withstanding mechanical shocks from transportation and rough handling. Furthermore, the new requirements for zero-emissions gas testing mean that the equipment not only has to remove a sample of pressurized gas from the GIS to measure it, but also has to store the sampled gas and then return it back to the pressurized compartment afterwards without any leaks. This makes any zero-emissions SF<sub>6</sub> gas analyzer hugely complicated and internal space is therefore at a premium.

The Rapidox SF<sub>6</sub> gas analyzer range has for a number of years used a Wi.Tec-Sensorik NDIR gas sensor module supplied in an ultra-compact housing with bespoke circuitry supplied on a flying lead to allow insertion into a very tight space. The gas is depressurized before it enters the IR module and flow controllers regulate the flow of test gas to a precise 0.5L.min<sup>-1</sup> allowing for changes in gas density as composition changes. After the gas is tested it enters an internal deflated storage bag which slowly fills until maximum capacity of five liters is reached over ten minutes. In reality, a full test takes a maximum of eight minutes, but this is largely to accommodate the H<sub>2</sub>O measurement which has a much slower response. Typically, the SF<sub>6</sub> reading from the IR sensor requires a maximum of two minutes to become stable and reliable.

With the storage bag full of gas, the operator can decide to either remove the gas to an external storage bottle or bag for recycling or, more commonly, pump back the gas to the pressurized vessel where it came from. This is done using a powerful internal compressor which can achieve pressures up to 10 bar on the return. Generally, SF<sub>6</sub> is extremely dry and clean but on occasions where significant toxic gases are detected, safety measures protect the NDIR gas sensor by rejecting contaminated gas before any harm can be done to the equipment.

For a successful and accurate measurement of SF<sub>6</sub>, the NDIR module must be fully temperature and pressure corrected over a wide range to accommodate all locations where humans live on planet Earth. For example, the Rapidox analyzer has to work correctly both in the 40°C heat of Dubai and the -10°C cold of Canada, as well as in high altitude places such as La Paz in South America at 3700 meters above sea level where atmospheric pressures fall below 700mbar.

Although the use of SF<sub>6</sub> Worldwide is expected to increase year on year for the rest of this decade, there are greener alternatives now available that are being slowly introduced. Gas mixtures of Novect<sup>TM</sup> C4 and C5 combined with CO<sub>2</sub> are in occasional use albeit with limited life, as well as mixtures of Dry Air and SF<sub>6</sub> / N<sub>2</sub> mixtures. All these gas types are relatively straightforward to measure using Wi.Tec-Sensorik NDIR gas sensors.

<sup>1</sup> Global Warming Potential



Figure 2: The Rapidox SF<sub>6</sub> Analyzer portfolio using Wi.Tec SF<sub>6</sub> NDIR gas sensors (INFRA.sens®).

### NDIR Gas Sensor

Sulfur hexafluoride can be measured with a high selectivity in the IR spectral range of 10-12µm. Cross-sensitivities due to gases present in the ambient air (e.g. CO<sub>2</sub>+H<sub>2</sub>O) can thus be excluded. In Figure 3 we can see a strong absorption line of SF<sub>6</sub> compared to CO<sub>2</sub> and H<sub>2</sub>O. Radiation absorption can be described by the Lambert-Beer law, as shown in Equation 1.

$$I(c) = I_0 \cdot \exp - [\alpha \cdot c \cdot L] \cdot \left[ \frac{T_0 \cdot p_M}{T_M \cdot p_0} \right] \quad [1]$$

with

I(c) = Intensity at the detector side with Nitrogen (zero gas)

I<sub>0</sub> = Intensity at the detector side without SF<sub>6</sub> gas (I<sub>0</sub>=1)

α = Coefficient of absorption [cm<sup>-1</sup>]

c = SF<sub>6</sub> gas concentration inside the sample cell [vol.%]

L = sample cell length [cm]

T<sub>0</sub> = Temperature during calibration process [K]

T<sub>M</sub> = Temperature in the application [K]

p<sub>0</sub> = Pressure during the calibration process [hPa]

p<sub>M</sub> = Pressure in the application [hPa]

Since the absorption coefficient α of SF<sub>6</sub> is very high in this spectral range and the concentration is also present up to 100% by volume, small measuring cells (1-5 mm) are sufficient. The optical arrangement is shown in Figure 4. The IR-radiation source

is electronically modulated with a frequency between f=1-10Hz. DC operation (f=0 Hz) is also possible with different type of IR-Detectors. The gas flow through the sample cell is typically 0.1-1 L.min<sup>-1</sup>. An integrated pressure sensor measured the real time situation of p and T inside the sample cell. Then a very precise compensation of the pressure (p) and temperature (T) influence is possible. The IR-Detector consist of two detector elements for reference and measurement signal generation. In front of each detector element a narrow bandpass interference filter is located.

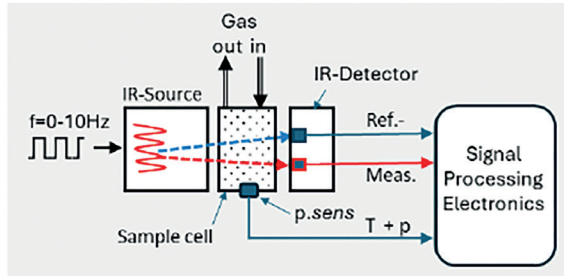


Figure 4: Optical arrangement of the NDIR Gassensor (INFRA.sens®).

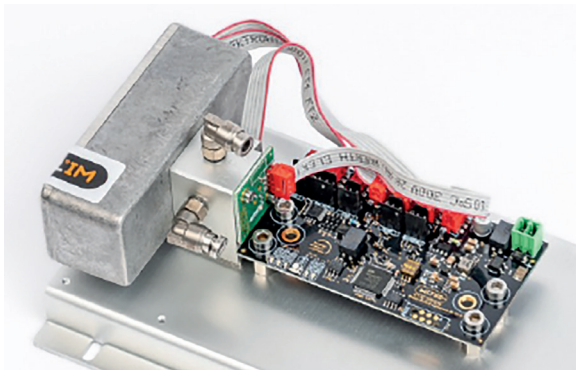


Figure 5: INFRA.sens® for 0-100 vol.% SF<sub>6</sub> including the complete signal processing electronic as well as the temperature and pressure compensation.

The downstream signal processing electronics process the raw signals into a linear display of the SF<sub>6</sub> gas concentration. Typically, the non-linear sensor signals are linearized by a higher order polynomial (see Fig.6). As the measuring range of 90-100 vol.% SF<sub>6</sub> is particularly interesting and important impurity control, particularly accurate compensation calculations are carried out in this concentration range. This means that the individual errors in this important concentration range are all less than 1% F.S.

As the characteristic curve is very steep between 90-100 vol% SF<sub>6</sub>, the temperature and pressure influences are very large. Therefore, the compensation of these error influences must be carried out very carefully. The simultaneous pressure and

temperature measurement is therefore carried out directly in the cuvette so that the true pressure and temperature values can be measured. Compensation takes place between p=600-1200 hPa and T=5-45°C. This means that error-free measurements can be carried out at high altitudes up to 4000 meters. The detection limit is <0.1vol.% (@zero) and <0.5vol.% (@span).

### Conclusion

NDIR technology has proven itself for measuring SF<sub>6</sub> purity in GIS systems. The INFRA.sens® product range is characterized by high accuracy and stability compared to comparable OEM gas sensors. By integrating this technology into the proven Rapidox series measuring devices, the measuring characteristics have been significantly improved. The possible applications of this device technology have also been expanded.

**Early Leak Detection:** SF<sub>6</sub> leaks can compromise the insulation of GIS, leading to potential failures. Early detection through continuous monitoring allows for immediate rectification, maintaining system integrity and reducing repair costs.

**Operational Efficiency:** By ensuring that the gas insulation levels are optimal, gas monitoring systems help maintain the operational efficiency of switchgear, thereby preventing unplanned outages.

**Compliance and Environmental Protection:** With SF<sub>6</sub> being a significant greenhouse gas, monitoring its levels is crucial for compliance with environmental regulations. NDIR Gas monitoring systems facilitate adherence to these regulations by providing accurate and reliable gas measurements.

**Enhanced Safety:** NDIR Gas monitoring systems contribute to safety by detecting gas leaks that could lead to dangerous conditions, ensuring the well-being of maintenance personnel and the facility.

### References

Wiegleb, G.: Gas Measurement Technology in Theory and Practice, Springer Verlag Wiesbaden 2023 (<https://doi.org/10.1007/978-3-658-37232-3>)

Regulation (EU) No 517/2014 of the European Parliament and of the Council of 16 April 2014 on fluorinated greenhouse gases and repealing Regulation (EC) No 842/2006 Text with EEA relevance

EPA US Environmental Protection Agency, Sulfur Hexafluoride Basics: <https://www.epa.gov/eps-partnership/sulfur-hexafluoride-SF6-basics>

Heise, H.M.: Gas analysis by infrared spectroscopy as a tool for electrical fault diagnostics in SF<sub>6</sub> insulated equipment. Fresenius J. Anal. Chem. 358(7), 793-799 (1997)

Kahrizi, L: SF<sub>6</sub> measurement guide, CIGRE-Publication (2018)

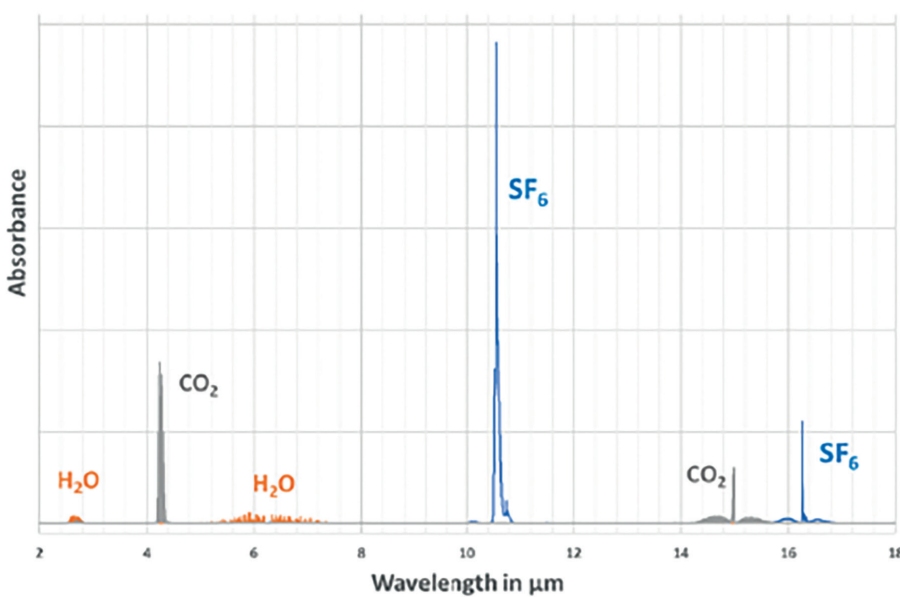


Figure 3: Infrared Spectrum of SF<sub>6</sub> in comparison of CO<sub>2</sub> and H<sub>2</sub>O.

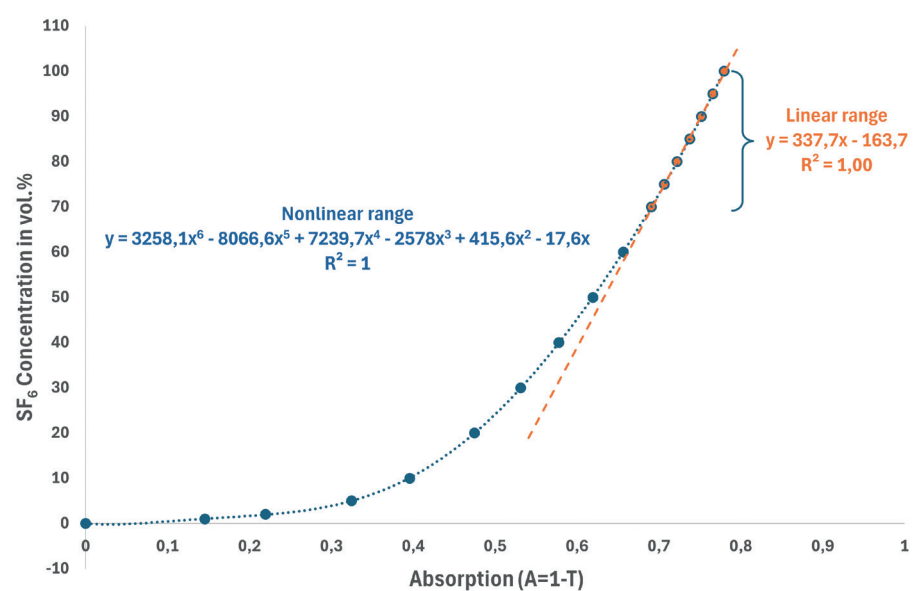


Figure 6: Calibration curve for 0-100 vol.% SF<sub>6</sub> in nitrogen approximated with a polynomial of 6 degrees (Linearization Fitting).

#### Author Contact Details

**Dr. Mark Swetnam**  
• Cambridge Sensotec Ltd.

- Address: 29 Stephenson Road St Ives, CAMBS, PE27 3WJ, UK
- Email: [mark@cambridge-sensotec.co.uk](mailto:mark@cambridge-sensotec.co.uk)
- Web: [www.cambridge-sensotec.co.uk](http://www.cambridge-sensotec.co.uk)



**Prof. Dr. Gerhard Wiegleb**  
• Wi.Tec-Sensorik GmbH

- Address: Schepersweg 41-61, D-46485 Wesel, Germany
- Email: [ge.wiegleb@witec-sensorik.de](mailto:ge.wiegleb@witec-sensorik.de)
- Web: [www.witec-sensorik.com](http://www.witec-sensorik.com)



**Alain Barillet**  
• Wi.Tec-Sensorik GmbH

- Address: Schepersweg 41-61, D-46485 Wesel, Germany
- Email: [al.barillet@witec-sensorik.de](mailto:al.barillet@witec-sensorik.de)
- Web: [www.witec-sensorik.com](http://www.witec-sensorik.com)

